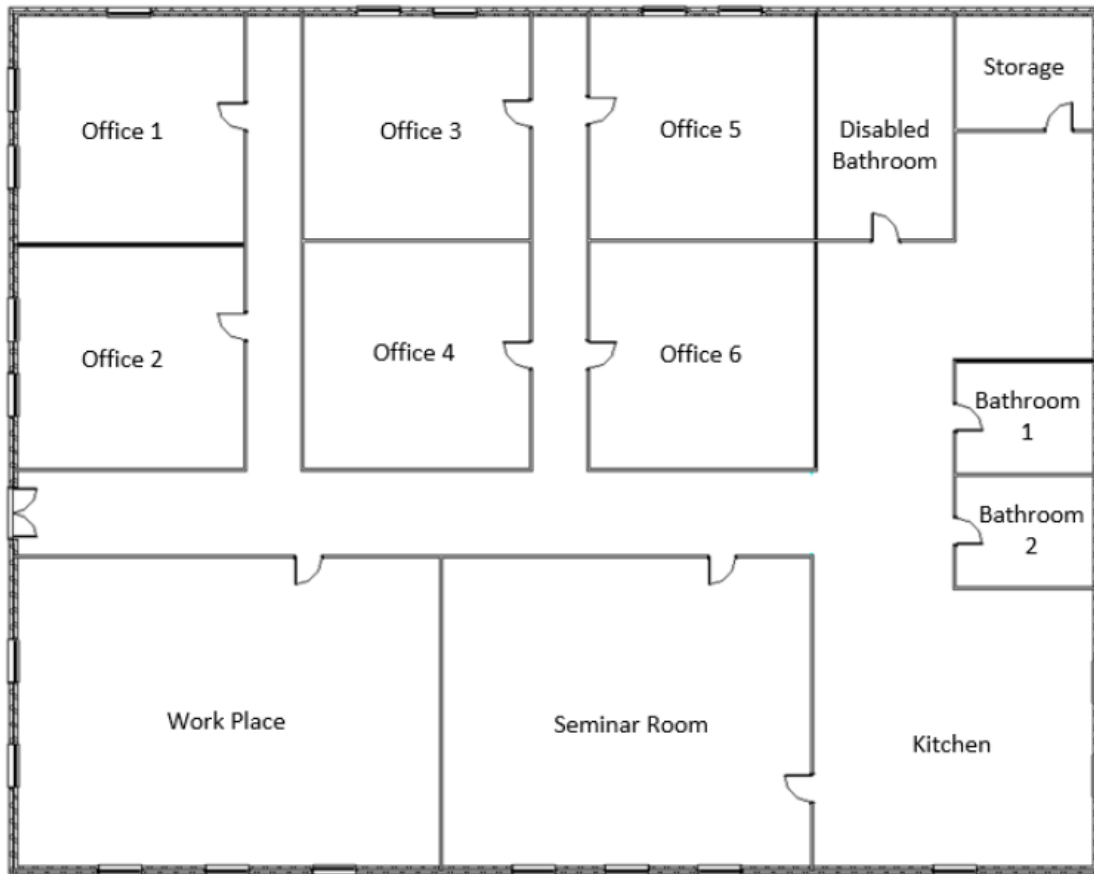


# FULL AIR SYSTEM SIZING

A.A 2024/25

Case Study 7						
Building data						
	Location	Venice, Italy				
	Building type	Office Building				
Geometrical data						
	Total floor area (m <sup>2</sup> )	1054.7				
	Number of floors	1				
	Window locations	Located on external walls				
	Shading surfaces	-				
	Height (m)	2.7				
	Windows size (m)	2.0 x 1.5				
Building Envelope						
	External wall	s [m]	λ [W/(m·K)]	cp [J/kg·K]	ρ [kg/m <sup>3</sup> ]	U [W/(m <sup>2</sup> ·K)]
	Brick	0.10	0.89	790	1920	0.57
	Wall air space resistance	0.04	0.27	1008	1	
	Insulation board	0.03	0.03	1210	43	
	Fiberboard sheathing	0.01	0.07	1300	400	
	Wall air space resistance	0.04	0.27	1008	1	
	Gyp board	0.02	0.16	1088	801	
	Internal wall	s [m]	λ [W/(m·K)]	cp [J/kg·K]	ρ [kg/m <sup>3</sup> ]	U [W/(m <sup>2</sup> ·K)]
	Internal plaster	0.01	0.7	1000	1400	1.58
	Concrete panel	0.2	0.58	1000	1400	
	Internal plaster	0.01	0.7	1000	1400	
	Roof	s [m]	λ [W/(m·K)]	cp [J/kg·K]	ρ [kg/m <sup>3</sup> ]	U [W/(m <sup>2</sup> ·K)]
	Built-up roofing	0.01	0.16	1460	1120	0.31
	Fiberboard sheathing	0.01	0.07	1300	400	
	Insulation board	0.08	0.03	1210	43	
	Lightweight concrete	0.10	0.53	840	1280	
	Ground contact floor	s [m]	λ [W/(m·K)]	cp [J/kg·K]	ρ [kg/m <sup>3</sup> ]	U [W/(m <sup>2</sup> ·K)]
	Porcelain floor	0.015	1.47	1000	1700	0.20
	Cement mortar	0.03	1.4	1000	2000	
	Lightened concrete	0.1	0.33	1000	1200	
	Scree	0.2	1.2	1000	1700	
	Ueq ground losses	0.15	0.035	1000	30	
	Windows	Visible trasmittance		Solar heat gain		U [W/(m <sup>2</sup> ·K)]
	Single glazing	0.7		0.7		3

In the following picture the floor plan of the office building is presented:



*Figure 1: Floor plan of the office building*

**Net floor area of the rooms:**

Office 1 = 59.29 m<sup>2</sup>

Office 2 = 59.29 m<sup>2</sup>

Office 3 = 59.29 m<sup>2</sup>

Office 4 = 59.29 m<sup>2</sup>

Office 5 = 59.29 m<sup>2</sup>

Office 6 = 59.29 m<sup>2</sup>

Work place = 157.29 m<sup>2</sup>

Seminar room = 135.89 m<sup>2</sup>

Disabled bathroom = 43.89 m<sup>2</sup>

Bathroom 1 = 19.74 m<sup>2</sup>

Bathroom 2 = 19.74 m<sup>2</sup>

Storage = 17.39 m<sup>2</sup>

Kitchen = 305.09 m<sup>2</sup>


Set point temperature for heating and cooling was assigned to each room.



Figure 2: Occupancy profiles and set point temperature for heating and cooling

## 1. Monthly heating and cooling energy demand

Attending only to the energy demand to be covered by the heating and cooling systems, the energy and instantaneous net power requirements throughout the year are shown below:

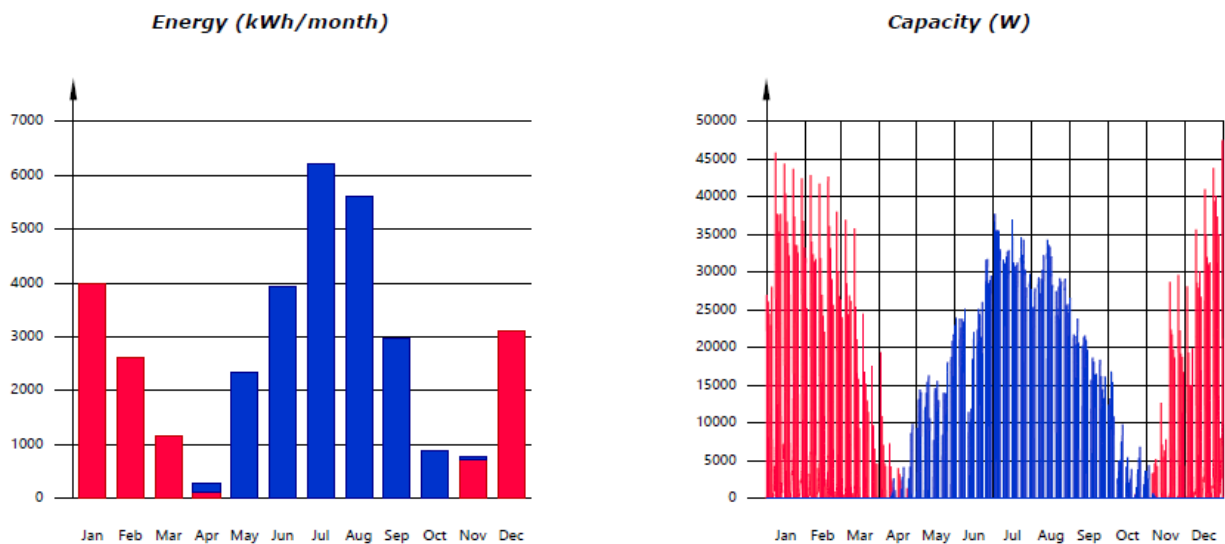

## 2. Peak load for heating and cooling

Heating peak load of the building = 45.74 kW

Cooling peak load of the building = 38.64 kW

Space	Peak Load Heating	Peak Load Cooling
Hallway	13.83	10.72
Office 1	2.85	3.09
Office 2	2.85	3.09
Office 3	2.48	1.87
Office 4	2.48	1.87
Office 5	2.48	1.85
Office 6	2.48	1.85
Work place	6.08	6.71
Seminar room	4.88	4.95
Disabled bathroom	1.58	0.92
Storage	1.58	0.92
Bathroom 1	1.10	0.63
Bathroom 2	1.10	0.63